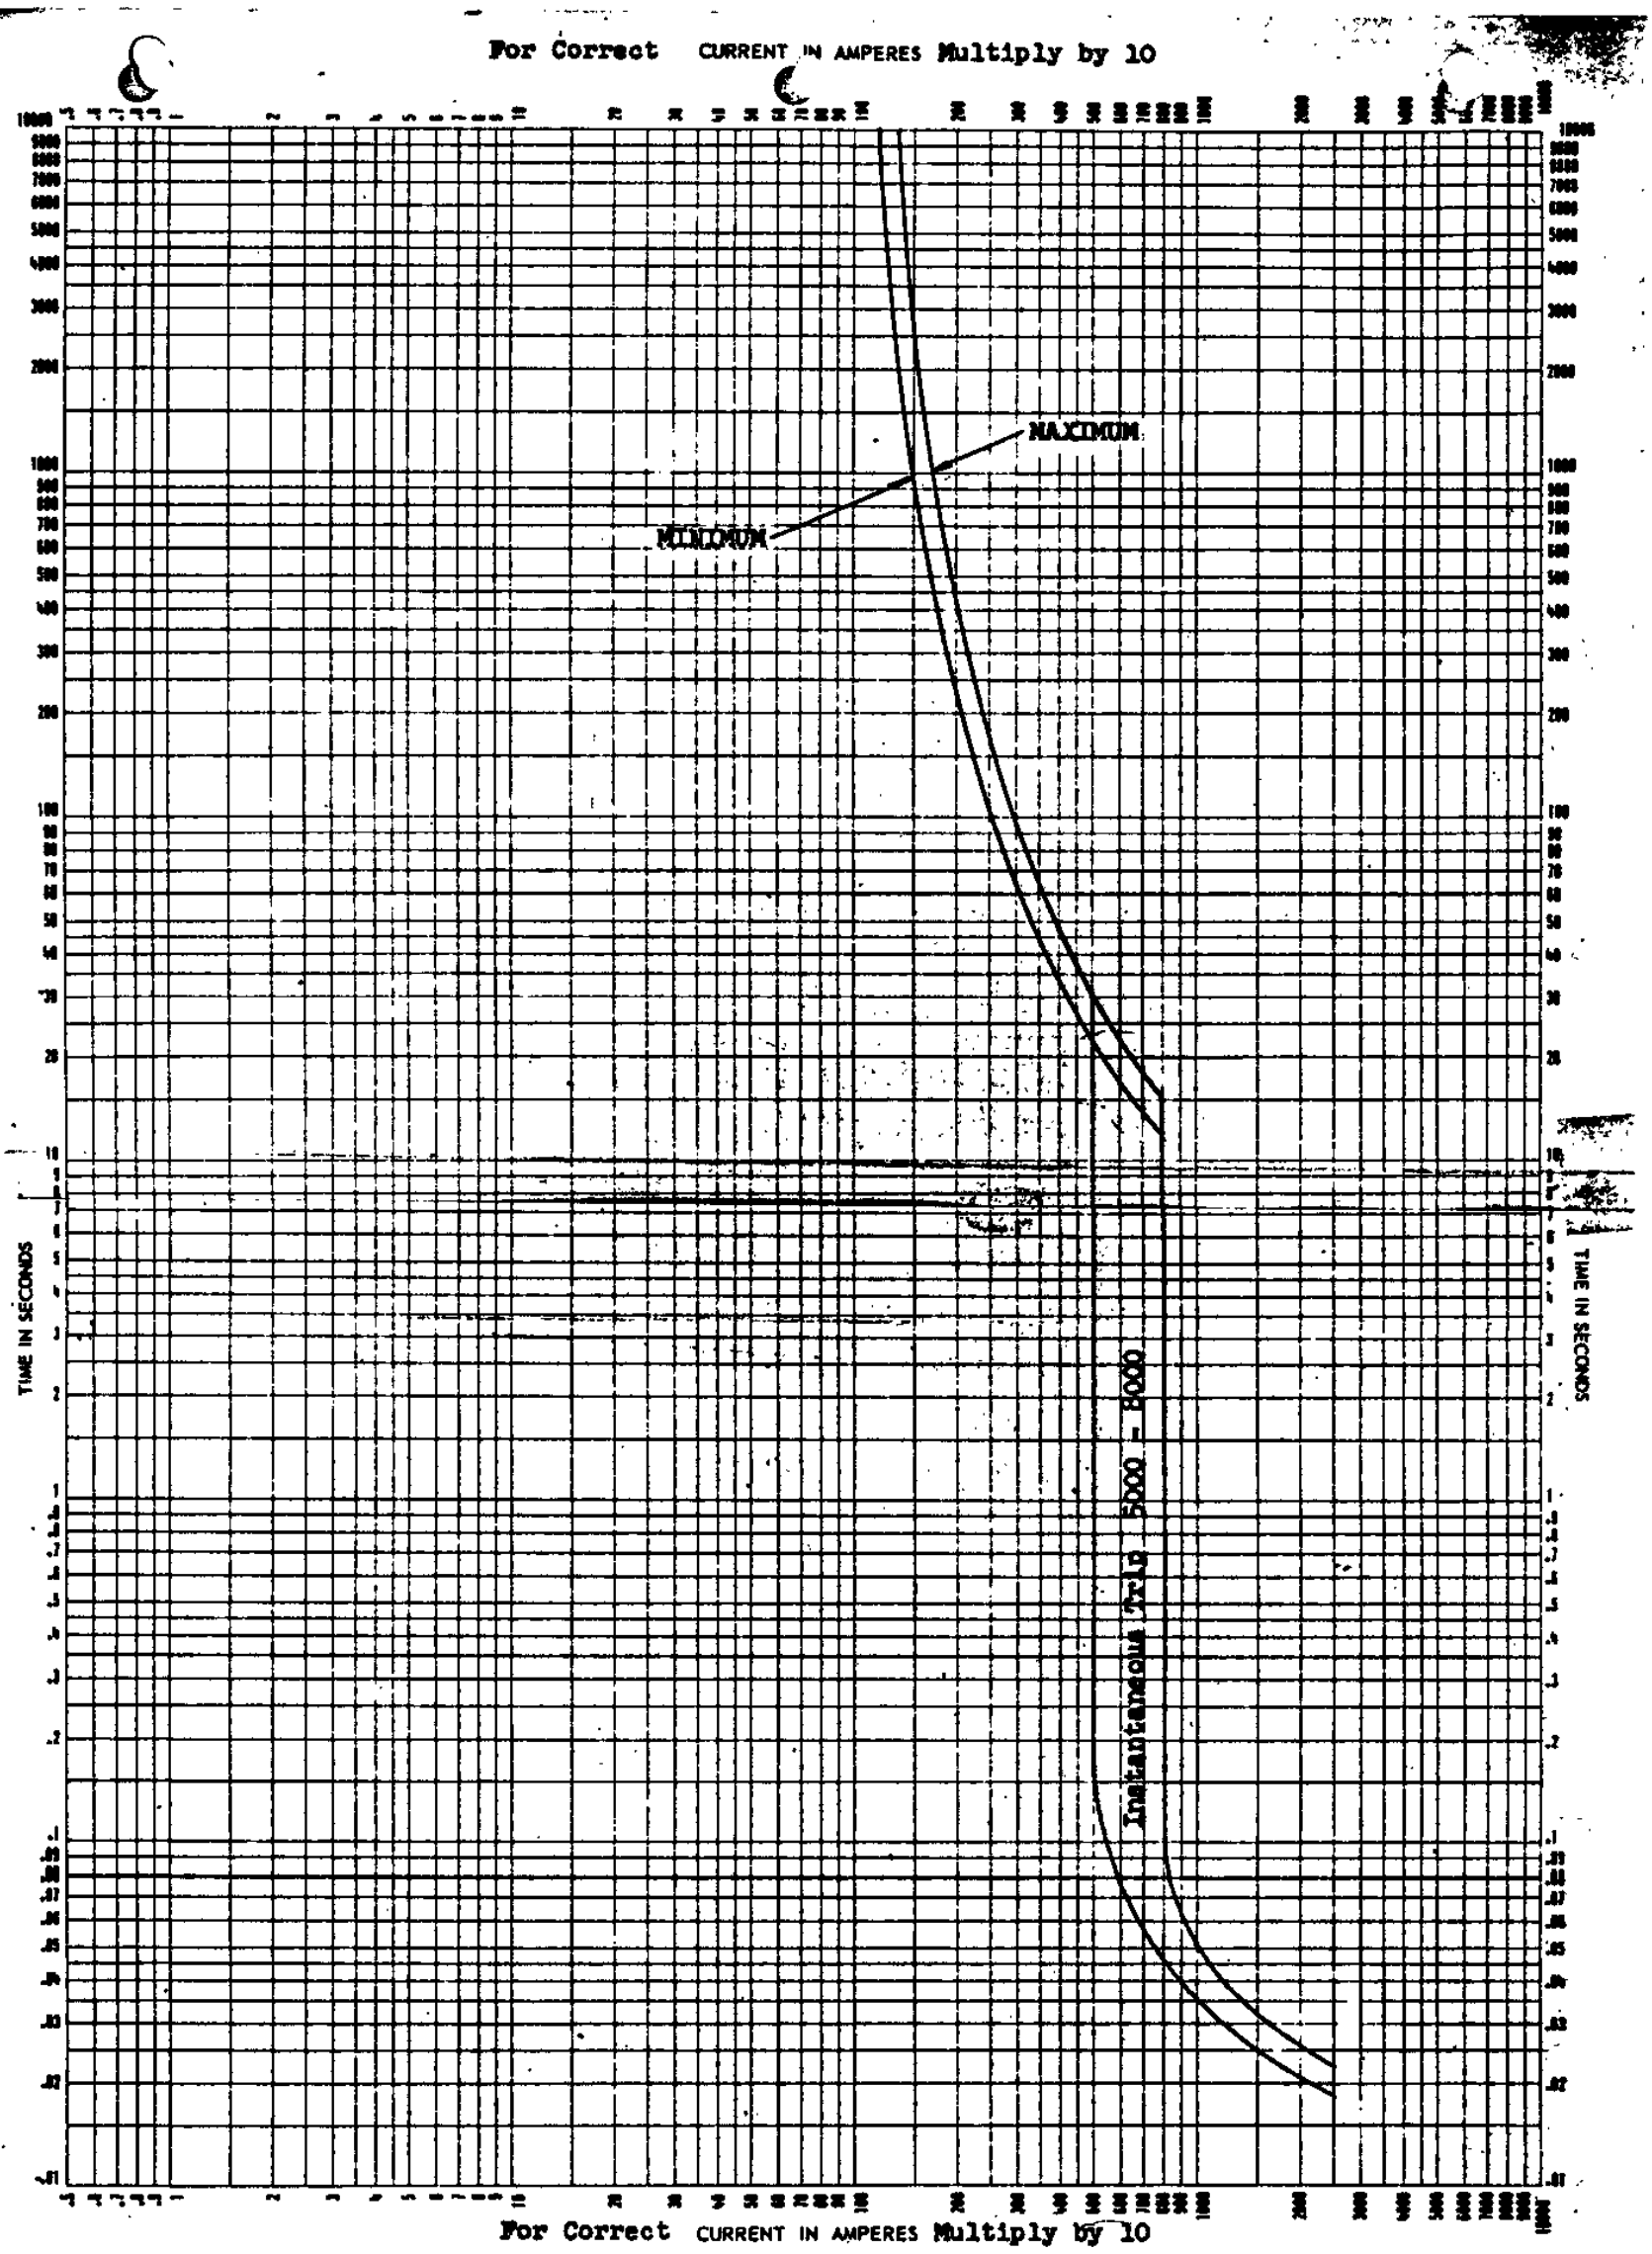

TIME-CURRENT CHARACTERISTIC CURVES 1200 Ampere, 3 Pole "HMP" Frame Circuit Breaker, 60 Cycles, 600 Volts A-C, 40C Ambient

ORDER NO.
TEST NO. FILE NO.
DWN. BY John Lundgren DATE Sept. 17 1964

NO. TD 4717 REV. 0

For Correct CURRENT IN AMPERES Multiply by 10

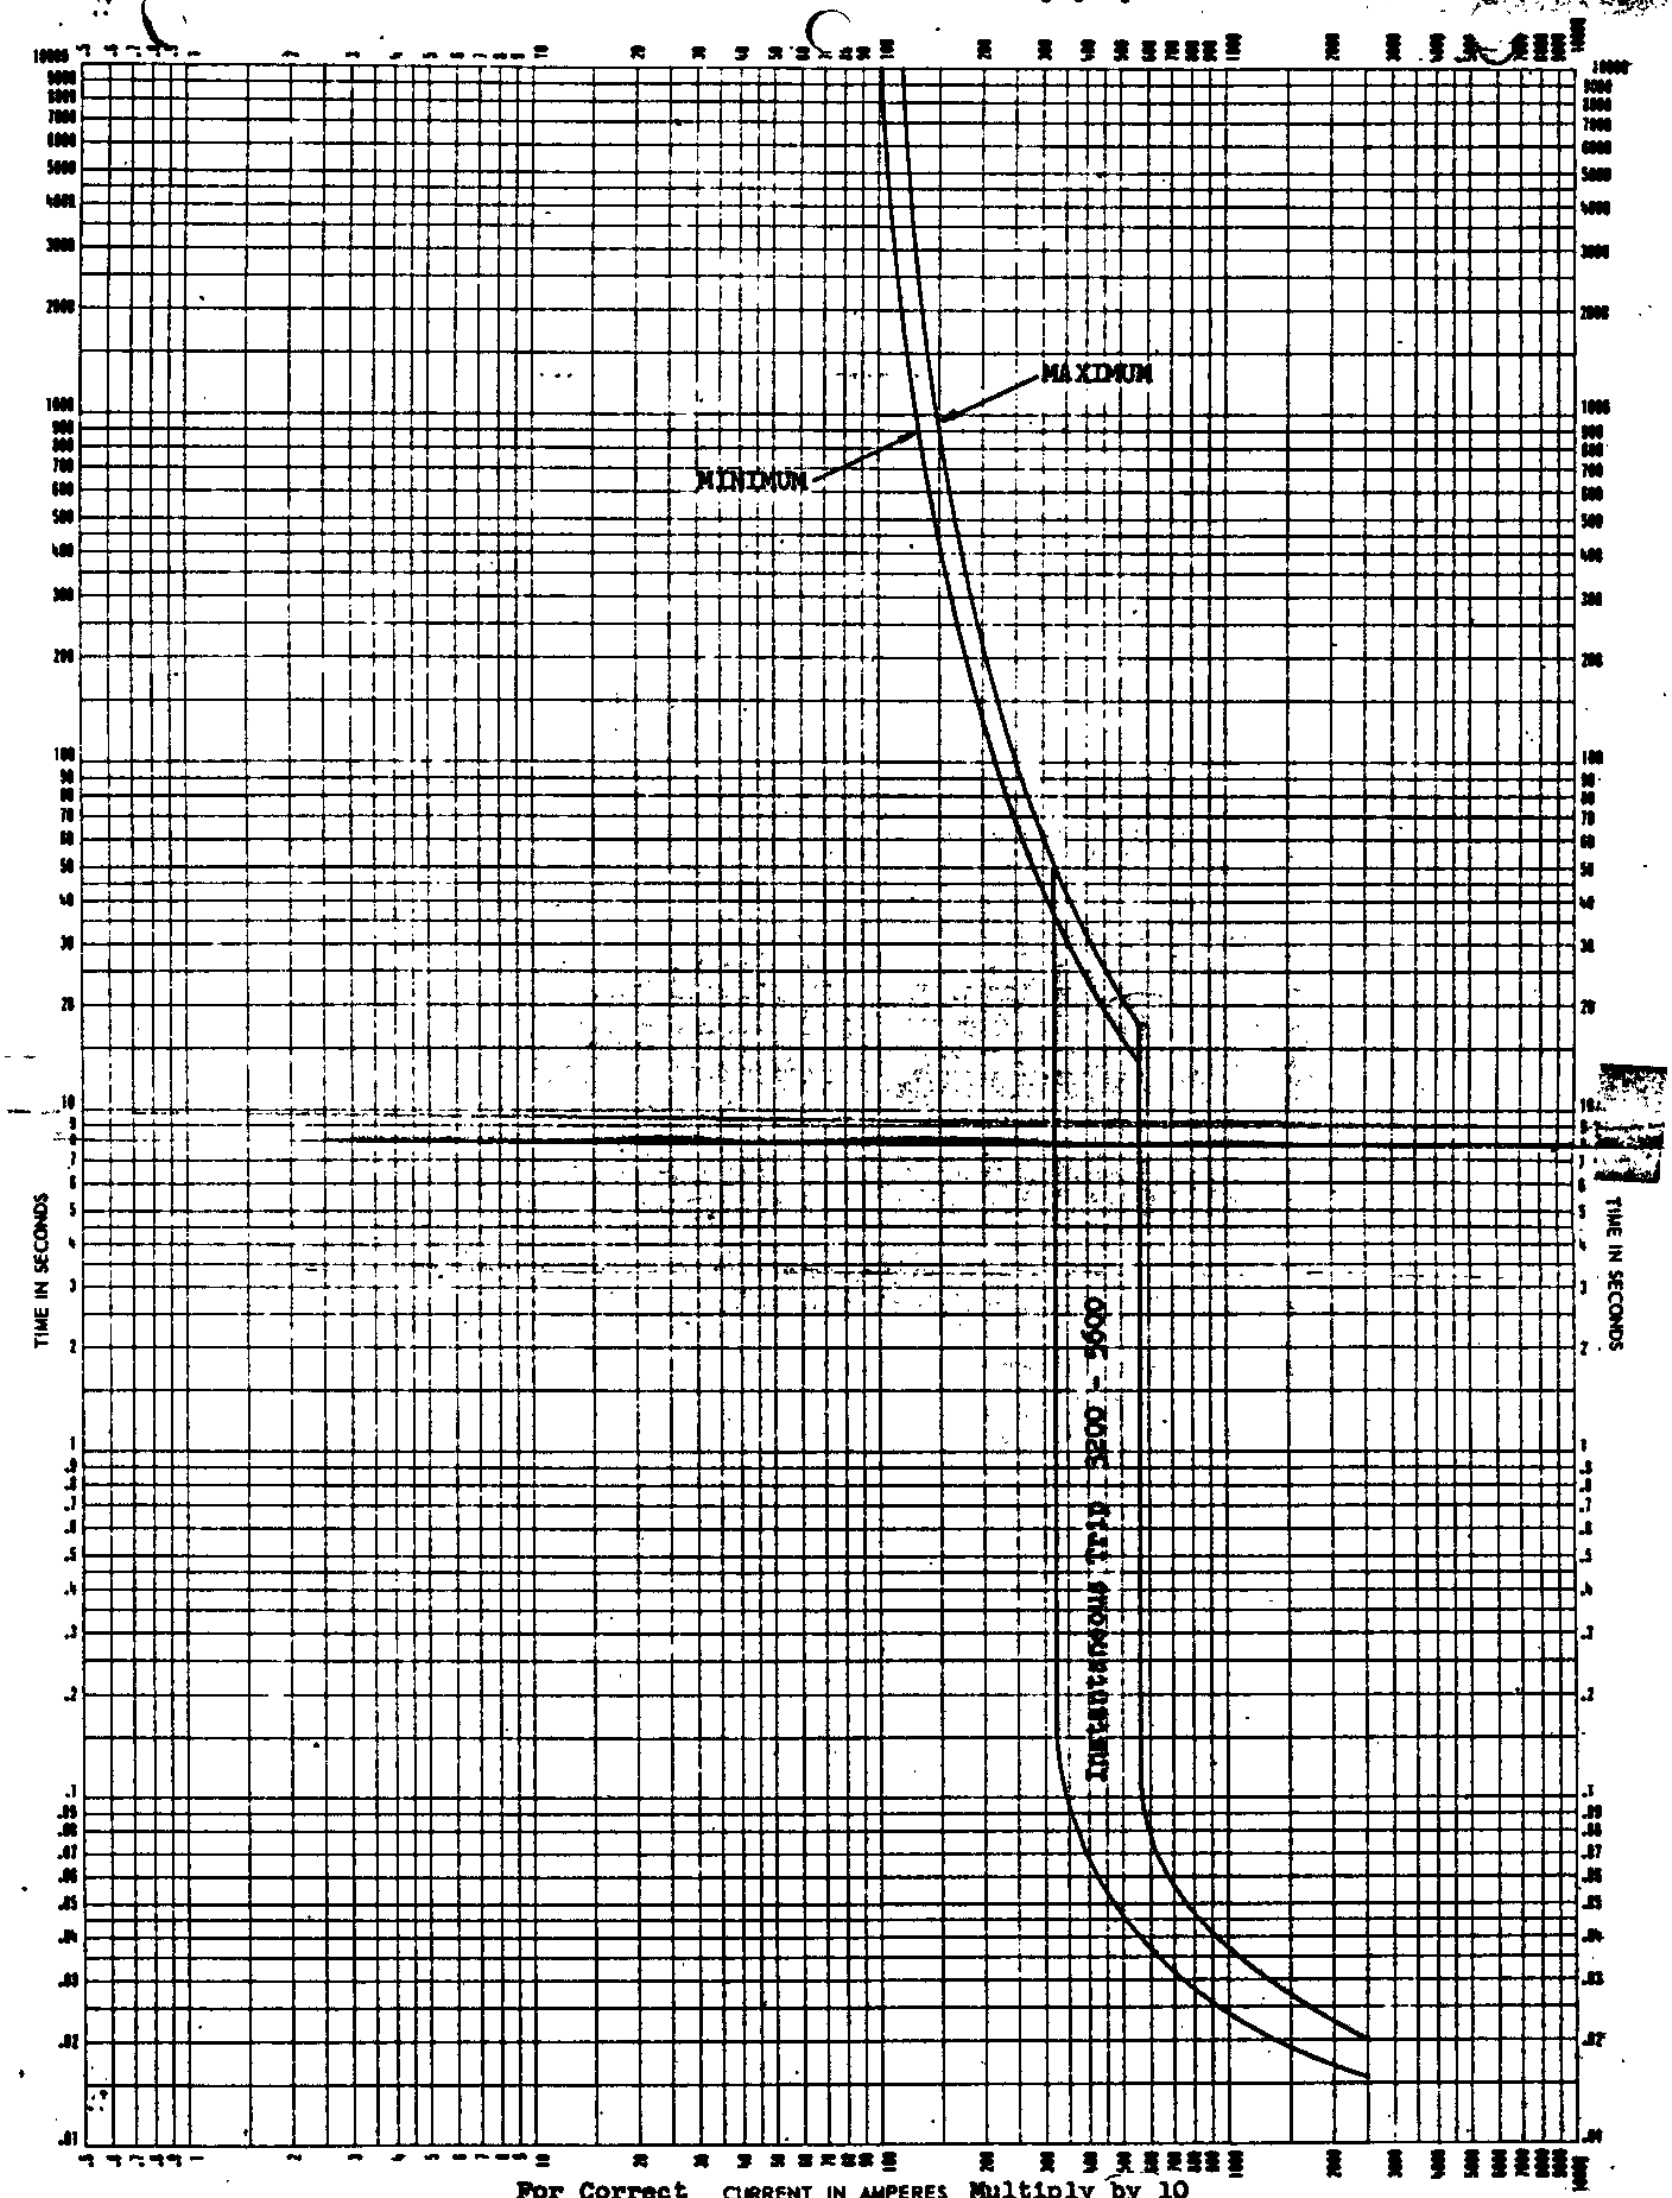

For Correct CURRENT IN AMPERES Multiply by 10

TIME-CURRENT CHARACTERISTIC CURVES 1000 Ampere, 3 Pole "HMP" Frame Circuit Breaker, 60 Cycles, 600 Volts A-C, 40C Ambient

ORDER NO.
TEST NO. FILE NO.
DWN. BY John Lundgren DATE Sept. 17 1964
NO. TD 4718 REV. 0

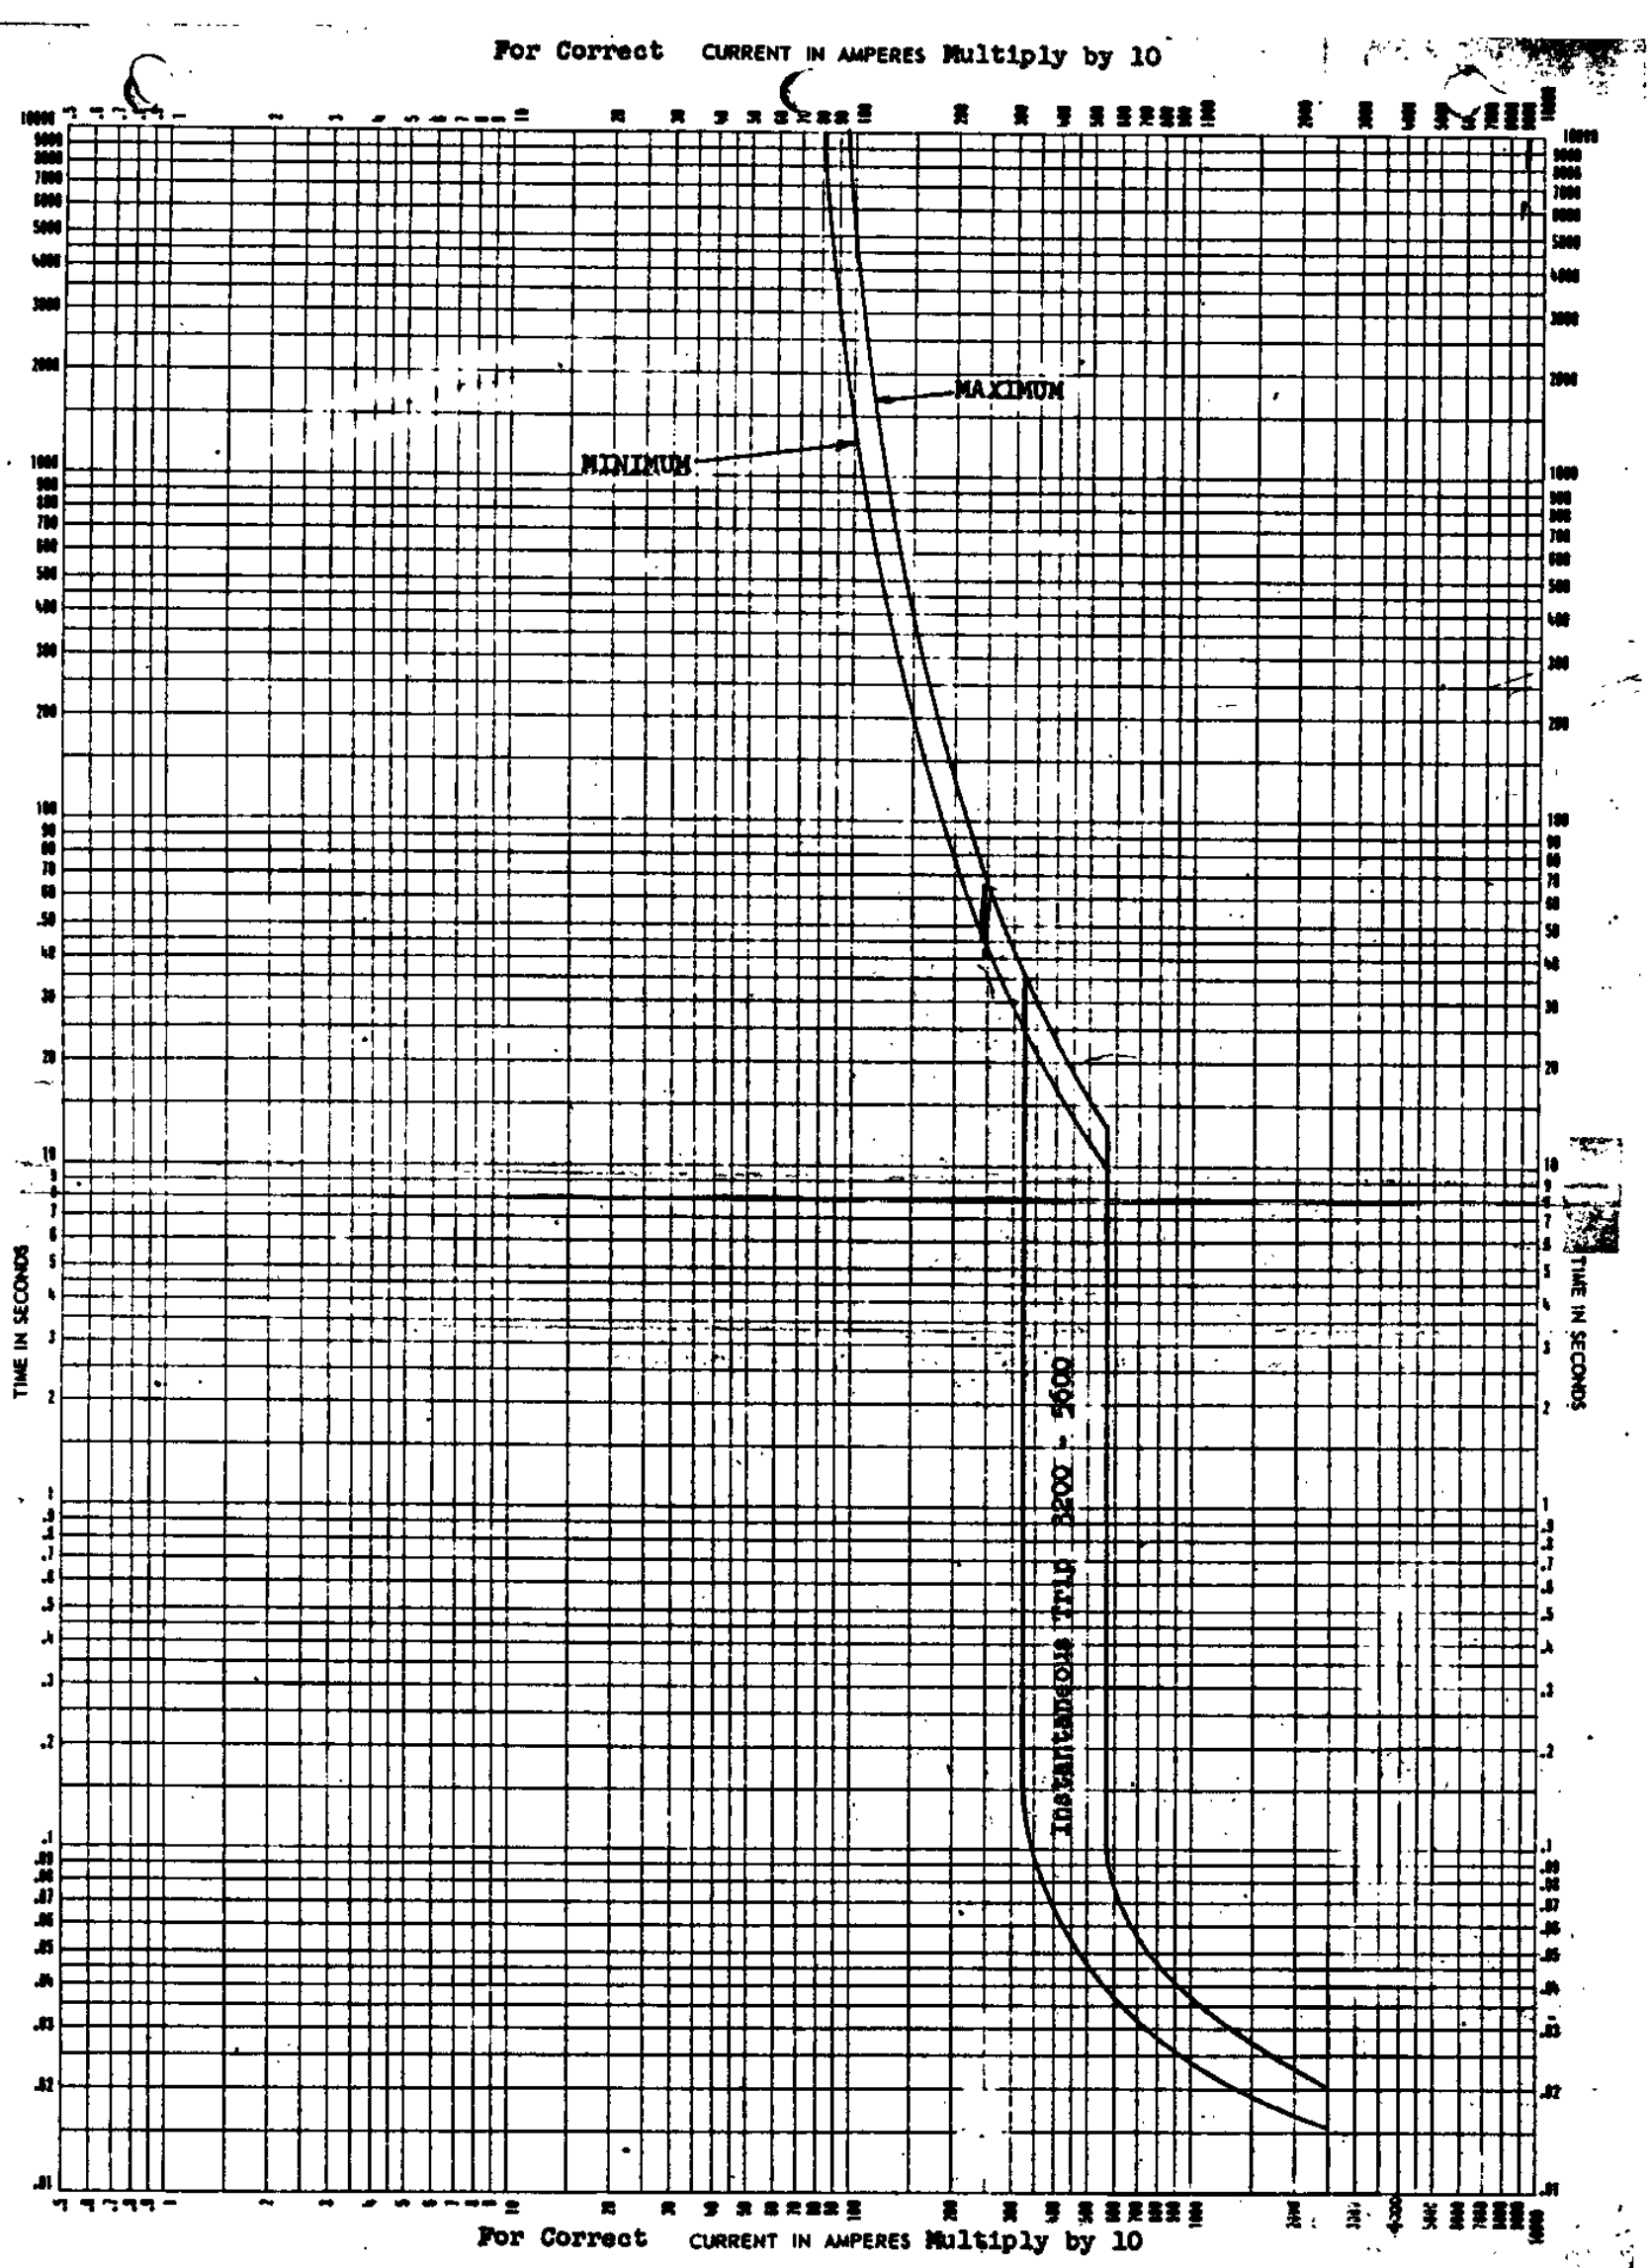

TIME-CURRENT CHARACTERISTIC CURVES 800 Ampere, 3 Pole "HMP" Frame Circuit Breaker, 60 Cycles, 600 Volts A-C, 40C Ambient

ORDER NO.
TEST NO. 4109 FILE NO.
DWN. BY John Lundgren DATE Sept. 17 1960

NO. TD 4719 REV. O